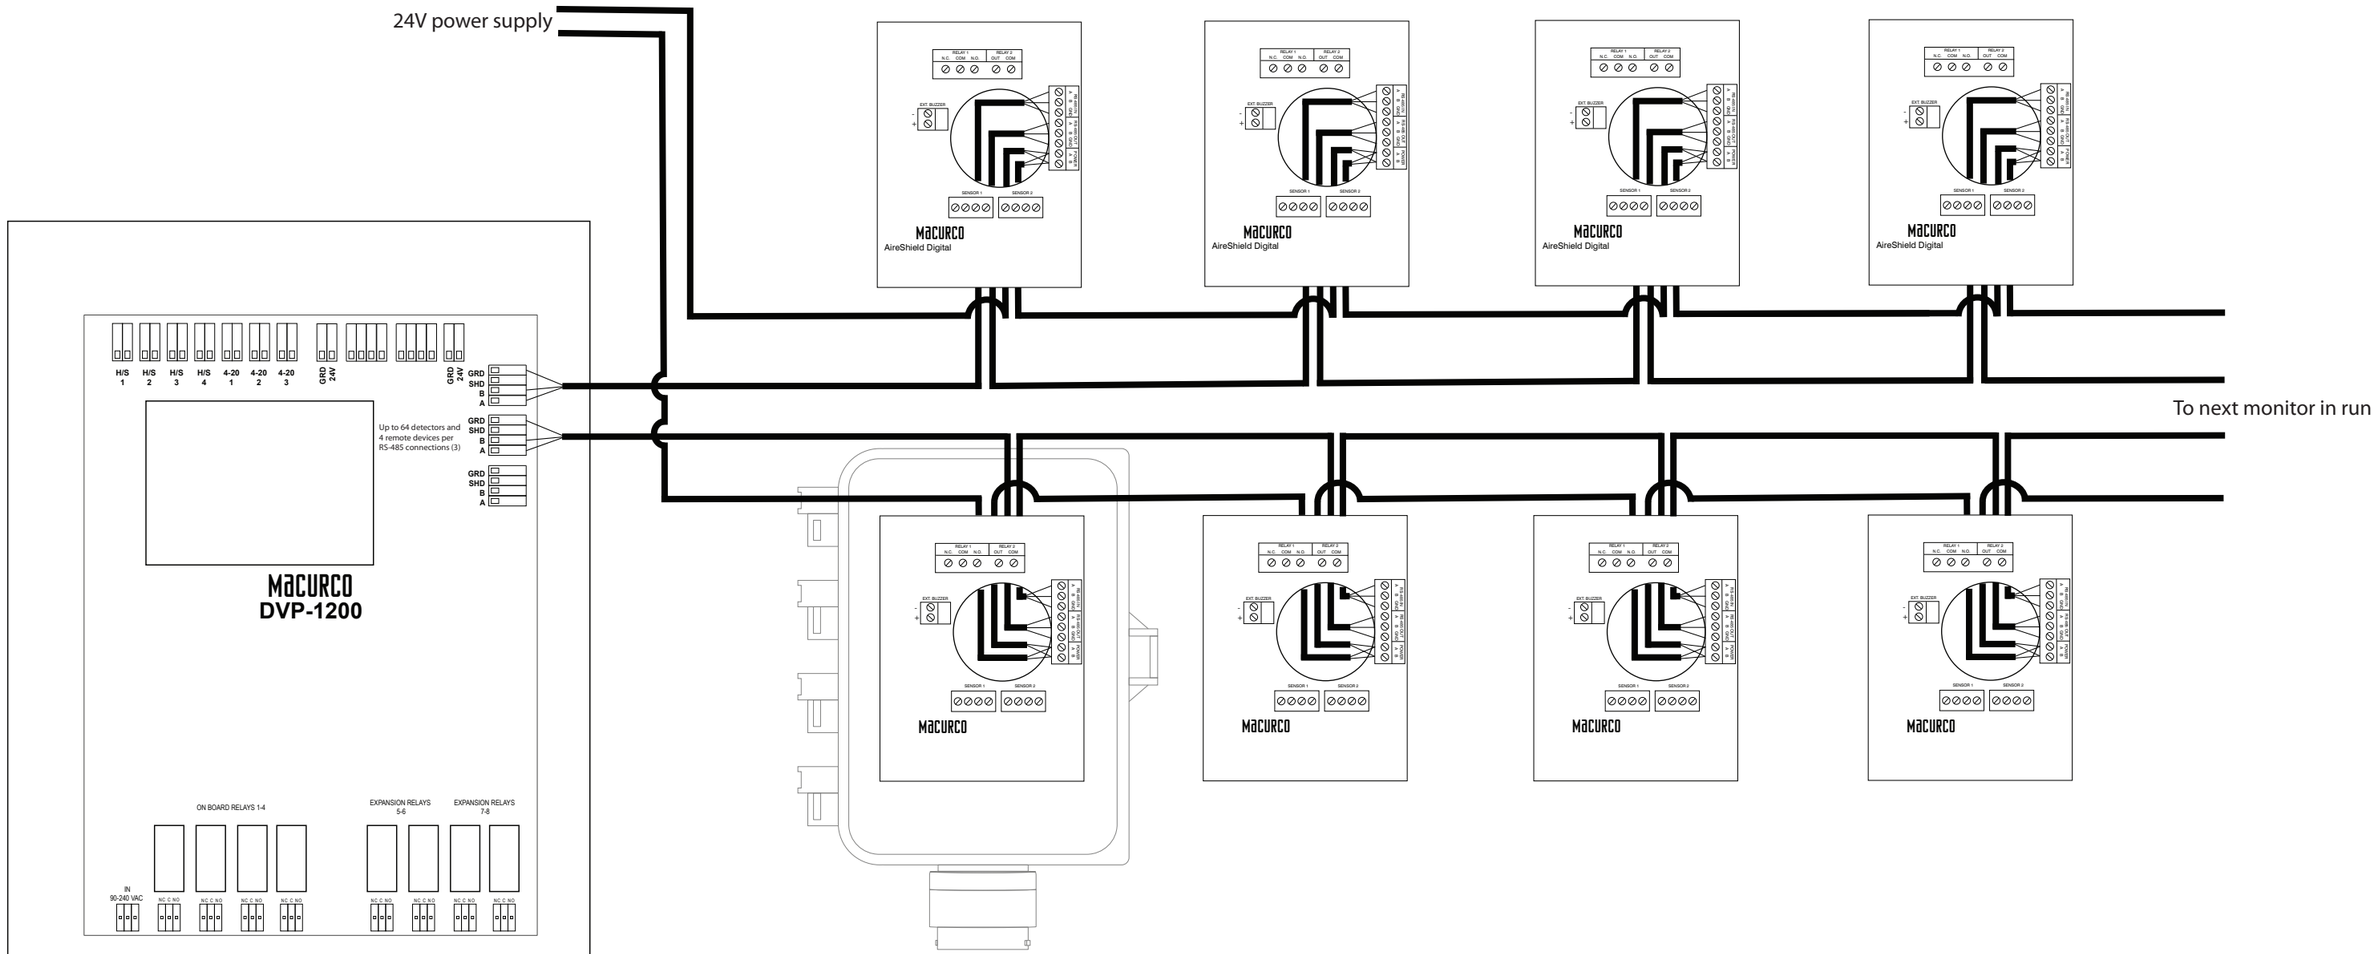



Notes:

1. For best performance on the RS-485 run, use shielded 3-conductor wire with one twisted pair providing a pair for signal (A & B) and common (COM)


MACURCO GAS DETECTION

Macurco Inc.
1504 West 51st Street
Sioux Falls, SD 57105
United States of America
1-877-367-7891


Macurco™ Building & Home Solutions

Title: DVP-1200 + AireShield
Rev.: 1.0
Date: 04-19-2024


All drawings are for reference only. Electrical diagrams / drawings must be reviewed and approved by a local governing authority prior to installation. Macurco makes no representation or warranty concerning wiring diagrams / drawings, and you are to rely solely on the recommendations and requirements of the local governing authority.