





Series IS626 Pressure Transducer


Specifications - Installation and Operating Instructions

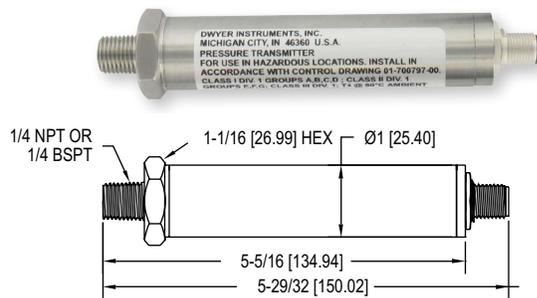


Male NPT/BSPT connector with male M-12 connector

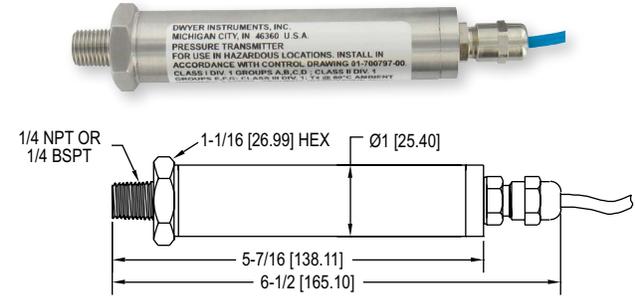

Male NPT/BSPT connector with cable gland

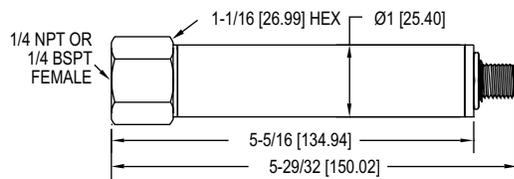

Female NPT/BSPT connector with male M-12 connector

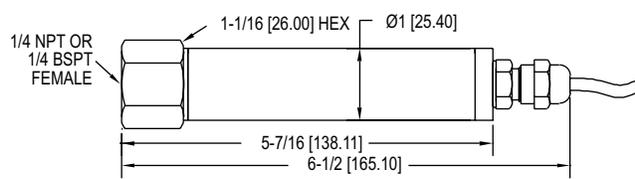

Female NPT/BSPT connector with cable gland

The Dwyer **Series IS626 Pressure Transducer** convert pressure into a standard 4-20 mA output signal. The Series IS626 can be used to accurately measure compatible gases and liquids. Series IS626 full scale accuracy is 0.25% (see specifications). Designed for industrial environments with a NEMA 4X (IP66) housing, this transmitter resists most effects of shock and vibration.

Intrinsic Safety Approval Classification

The IS626 is UL listed for use in Hazardous (Classified) Locations. The protection method is by Intrinsic Safety, "ia". It was investigated by UL under UL Standard 913 8th Edition, CAN/CSA C22.2 No. 60079-0:15 and CAN/CSA C22.2 No. 60079-11:14.

Hazardous (Classified) Location Intrinsically Safe For:

Class I Div. 1 Groups A,B,C,D
 Class II Div. 1 Groups E,F,G
 Class III Div. 1
 Class I Zone 0 AEx ia IIC T4 Ga
 Zone 20 AEx ia IIIC T135°C Da
 Ex ia IIC T4 Ga
 Ex ia IIIC T135°C Da
 Ta = -20°C to 80°C

Install in accordance with Control Drawing 001833-42.

See Control Drawing 001833-42 for Entity Parameters.

SPECIFICATIONS

Service: Compatible gases and liquids.

Wetted Materials: Type 316, 316L SS.

Accuracy: 0.25% FS (includes linearity, hysteresis, and repeatability).

Temperature Limit: -4 to 176°F (-20 to 80°C).

Compensated Temperature Range: -4 to 176°F (-20 to 80°C).

Thermal Effect: $\pm 0.02\%$ FS/°F (includes zero and span).

Pressure Limits: 2X FS.

Power Requirements: 10-28 VDC.

Output Signal: 4-20 mA.

Response Time: 50 msec.

Loop Resistance: 0-900 Ω max.

Current Consumption: 38 mA (max).

Electrical Connections: 3 ft. cable or 4-pin M-12 connector.

Process Connection: 1/4" male/female NPT and BSPT.

Enclosure Rating: NEMA 4X (IP66) (Self declared by Dwyer Instruments, LLC).

Mounting Orientation: Mount in any position.

Weight: 8.9 oz (252 g).

Agency Approvals: CE, See Intrinsic Safety Approval Classification.

WARNING Use with approved safety barriers using entity evaluation.

Aluminum tag must be removed prior to installation for all units supplied with aluminum tag option Suffix "AT".

CAUTION Do not exceed specified supply voltage ratings. Permanent damage not covered by warranty will result. This device is not designed for 120 or 240 VAC operation. Use only on 10-28 VDC.

INSTALLATION

- Location:** Select a location where the temperature of the transducer will be between -4 and 176°F (-20 to 80°C). Distance from the receiver is limited only by total loop resistance. The tubing or piping supplying pressure to the unit can be practically any length required but long lengths will increase response time slightly.
- Position:** The transducer is not position sensitive. However all standard models are originally calibrated with the unit in a position with the pressure connection downward. Although they can be used at other angles, for best accuracy it is recommended that units be installed in the position calibrated at the factory.
- Pressure Connection:** Use a small amount of plumber's tape or other suitable sealants to prevent leaks. Be sure the pressure passage inside the port is not blocked.
- Electrical Connections:**
Wire Length - The maximum length of wire connecting the transducer and receiver is a function of wire size and receiver resistance. Wiring should not contribute more than 10% of the receiver resistance to total loop resistance. For extremely long runs (over 1000 feet), choose receivers with higher resistance to minimize the size and cost of connecting leads. Where wiring length is under 100 feet, wire as small as 22 AWG can be used.

- Wiring:**
 An external power supply delivering 10-28 VDC with minimum current capability of 40 mA DC (per transducer) is required to power the control loop. See Figure A for connection of the power supply, transducer and receiver. The range of appropriate receiver load resistance (RL) for the DC power supply voltage available is expressed by the formula:

$$R_{L \max} = \frac{V_{ps} - 12.3 \text{ V}}{20 \text{ mA}}$$

Shielded cable is recommended for control loop wiring.

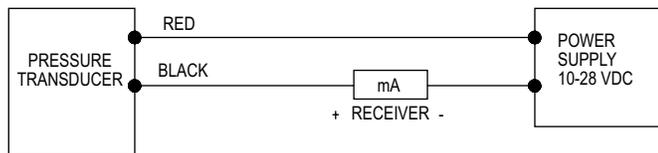


Figure A

When using cable version IS626, black wire is negative [-] and red wire is positive [+]. When using 4-pin M-12 connector models, wire to pins as shown below in Figure B.



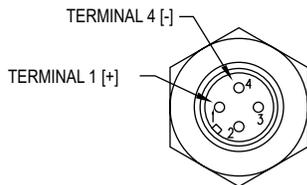


Figure B: Male-12 connector

ACCESSORIES

A-295 Female M-12 Connector

A female 4 position M-12 connector for use in connecting to the M-12 male connector on the IS626. Fit 0.16" to 0.29" diameter cables with a maximum wire gage at 18 AWG (0.75 mm²).

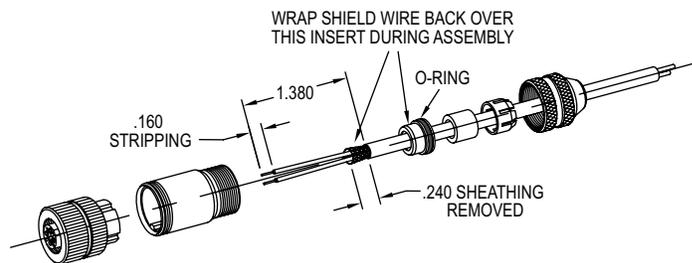

Accessory A-295: Female M-12 connector

A-231 Shielded Cable

A pre-made 16.4 ft (5 m) cable with a 4 pin Female M-12 connector is available for use when connecting to the male M-12 connector on the IS626. Black wire is negative and the brown wire is positive.


MAINTENANCE

After final installation of the pressure transducer and its companion receiver, no routine maintenance is required. A periodic check of system calibration is suggested. The Series IS626 transducers are not field repairable and should be returned if repair is needed (field repair should not be attempted and may void warranty). Be sure to include a brief description of the problem plus any relevant application notes. Contact customer service to receive a return goods authorization number before shipping.

- NOTES:
1. SELECTED ASSOCIATED APPARATUS MUST BE THIRD PARTY LISTED AS PROVIDING INTRINSICALLY SAFE CIRCUITS FOR THE APPLICATION, AND NOT EXCEED THE ENTITY PARAMETERS LISTED IN THIS DRAWING.
 2. ASSOCIATED APPARATUS OUTPUT CURRENT MUST BE LIMITED BY A RESISTOR SUCH THAT THE OUTPUT VOLTAGE-CURRENT PLOT IS A STRAIGHT LINE DRAWN BETWEEN OPEN-CIRCUIT VOLTAGE AND SHORT-CIRCUIT CURRENT.
 3. CAPACITANCE AND INDUCTANCE OF THE FIELD WIRING FROM THE INTRINSICALLY SAFE TRANSDUCER TO THE ASSOCIATED APPARATUS SHALL BE CALCULATED AND MUST BE INCLUDED IN THE SYSTEM CALCULATIONS AS SHOWN IN THIS DRAWING.
 4. TRANSDUCERS MUST BE INSTALLED TO THE MANUFACTURER'S CONTROL DRAWING AND ARTICLE 504 OF THE NATIONAL ELECTRICAL CODE (ANSI/NFPA 70) FOR INSTALLATION IN THE UNITED STATES OR SECTION 18 OF THE CANADIAN ELECTRICAL CODE (CSA C22.1) FOR INSTALLATION IN CANADA OR OTHER LOCAL INSTALLATION CODES, AS APPLICABLE.
 5. THE ASSOCIATED APPARATUS MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED WHEN INSTALLING THE EQUIPMENT.
 6. NO REVISIONS TO THIS DRAWING WITHOUT PRIOR APPROVAL BY UL.

HAZARDOUS AREA
CLASS I, DIV.1
ZONE 0
ZONE 20
IIC
IIC

NON-HAZARDOUS AREA

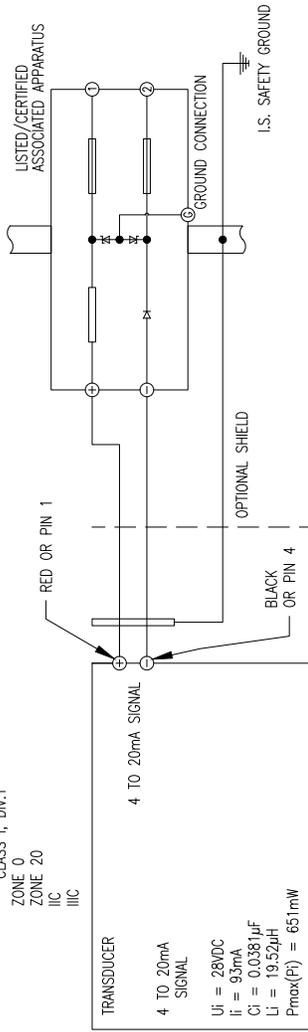

ASSOCIATED APPARATUS

- $V_{oc} (V_o) \leq 28V$
- $I_{sc} (I_o) \leq 93mA$
- $P_o (P_o) \leq 0.651W$
- $C_a (C_o) \geq 0.0381\mu F + C \text{ cable}$
- $L_a (L_o) \geq 19.52\mu H + L \text{ cable}$

Ⓢ = CRITICAL DIMENSION
STANDARD TOLERANCES UNLESS NOTED:
ALL DECIMAL DIMENSIONS ± .005
ALL ANGLES ± 1°

MATERIAL		NAME	
2	UPDATING STANDARDS FOR AGENCY PER ECR-048314	DATE	02-09-18
1	GENERAL REVISION AS REQUESTED BY UL PER ECR #43410	DWN BY	AMS
0	INITIAL RELEASE NP-005145	CHKD	DGH
		BY/DATE	02-28-18
		APPRD	LR
		CHANGES	
<p>NOTICE: This drawing and the principles and elements of design embodied therein are the exclusive property of DWYER INSTRUMENTS and are not to be reproduced, stored in a retrieval system, or used in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of DWYER INSTRUMENTS.</p>			
IS626		I.S. CONTROL DRAWING	
FINISH			
<p>DWYER INSTRUMENTS, LLC. MICHIGAN CITY, INDIANA 46360 U.S.A.</p>			
FR. NO. 001833-42			4

ZONE AND DIVISION ENTITY PARAMETERS ARE SHOWN AS: DIVISION (ZONE)

